














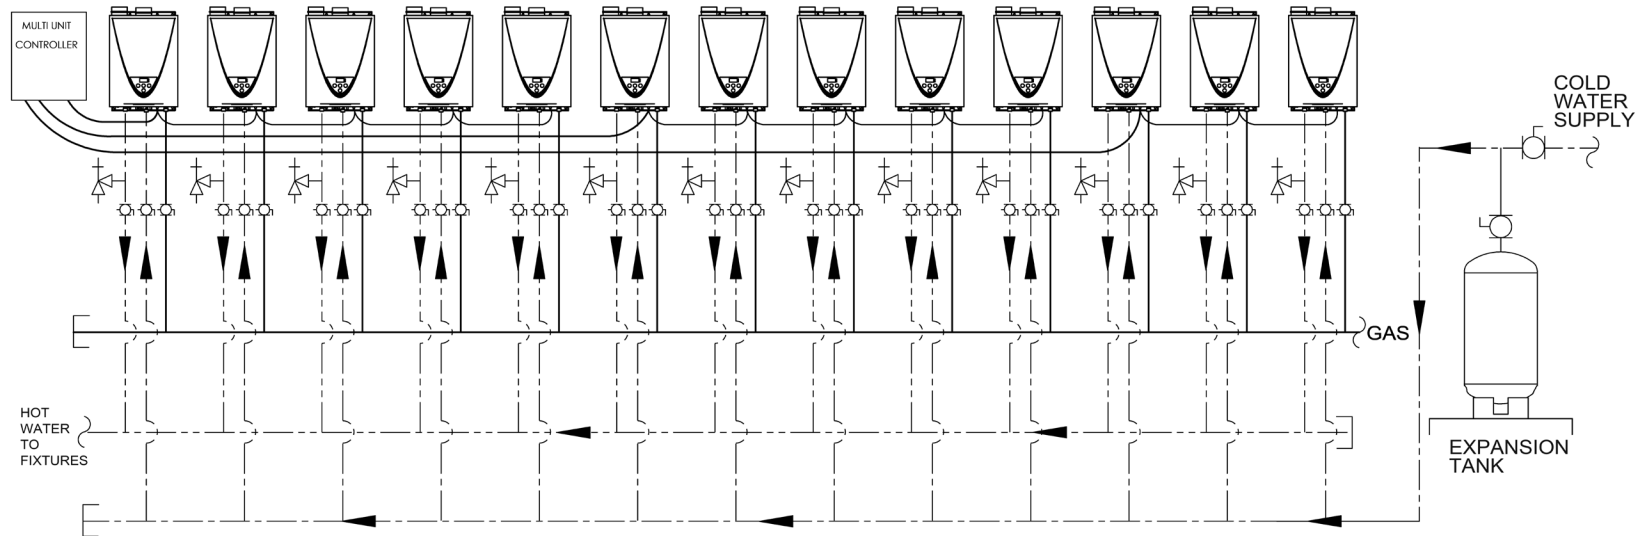
SCT-199 - THIRTEEN WATER HEATERS, DIRECT PLUMBING WITH NO RECIRCULATION

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

DRAWING SHOWS INDOOR UNITS. OUTDOOR UNITS ARE PIPED IN THE SAME MANNER.

LEGEND

| | | | | | |
|---|-------------------------------------|---|-------------------|---|-----------------|
|  | TEMPERATURE & PRESSURE RELIEF VALVE |  | BALL VALVE |  | COLD |
|  | PRESSURE RELIEF VALVE |  | TEMPERATURE GAUGE |  | HOT |
|  | CIRCULATING PUMP |  | CHECK VALVE |  | BUILDING RETURN |
|  | TEMPERATURE CONTROL PROBE |  | WATER FLOW SWITCH |  | GAS |
|  | DRAIN | | | | |



NOTES:

1. Installation of a device to minimize scale deposits, such as the Product Preservers®, water softener, etc. should be considered. Refer to the heater's installation manual for additional information and/or consult with a local water quality expert.
2. Gas supply line shall be sized per the heater's installation manual and the current edition of ANSI Z223.1/NFPA 54.